

Loop Powered Device

MGT-0420-001

Universal 4-20mA True RMS Signal Transducer

Application:

- The MGT-0420-001 signal transducer converts zero to 333 mV AC signal to standard 4 to 20 mA DC voltage.
- This device is not recommended for use with the Magnelab RCS unit (See MGS-1800 Series for three-phase applications)
- The MGT-0420-001 helps to reduce inventory by allowing the measurement of various signals by simply changing the input device.



ORDER INFORMATION			
Part Number	Input	Output	Accuracy (Full Scale)
MGT-0420-001	0-333mV	4 - 20 mA	0.3%


Features:

- Highly accurate, true RMS measurement
Ideal for distorted waveforms
- Self-powered from the 4 - 20 mA loop
- Robust construction, compact size and easy wiring

DIMENSION	INCH	MM
A	3.00	76.2
B	1.10	20.0
C	0.54	13.7
D	2.60	66.0
E	0.18	4.6

Specifications:

- Power: Standard 4-20 mA loop voltage 8 - 35 VDC
- Input: 0-333mV full scale AC voltage
- Output: 4 -20 mA loop (Sinking)
Max. impedance 750 Ω @ 24VDC
(Barrier strip terminal provided)
- Accuracy: True RMS, 0.3% Full scale,
up to crest factor 4
- Frequency: 40 to 3000 Hz
- Enclosure: Potted plastic box
Back mounting bracket

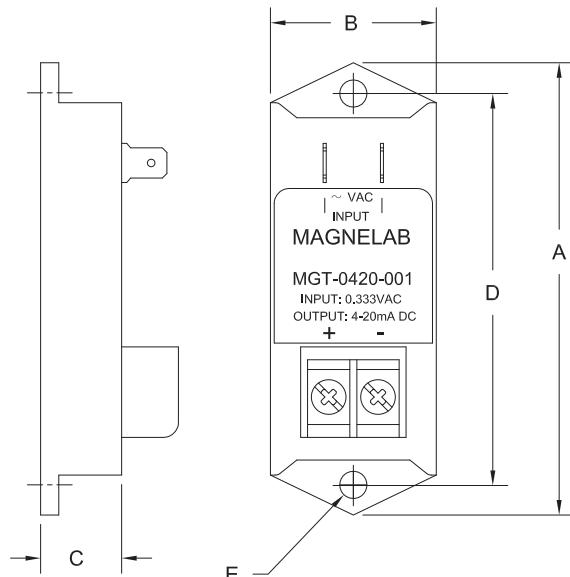

Loop Powered Device

MGT-0420-001

Universal 4-20mA True RMS Signal Transducer

